

www.ijerph.org

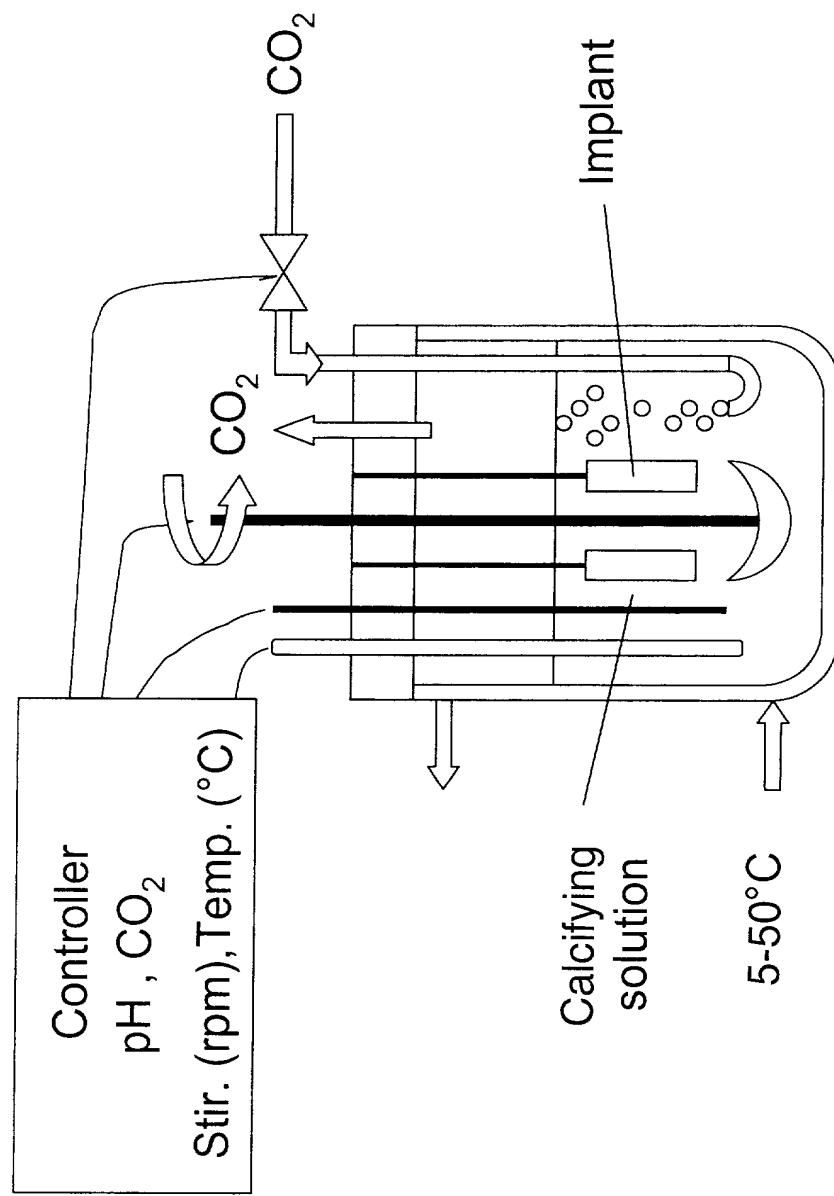


FIG. 1

Figure 2 shows the pH change of calcifying solutions over time. The y-axis represents pH from 3.5 to 9.5, and the x-axis represents soaking time in hours from 0 to 24. A dashed line indicates the pH of water.

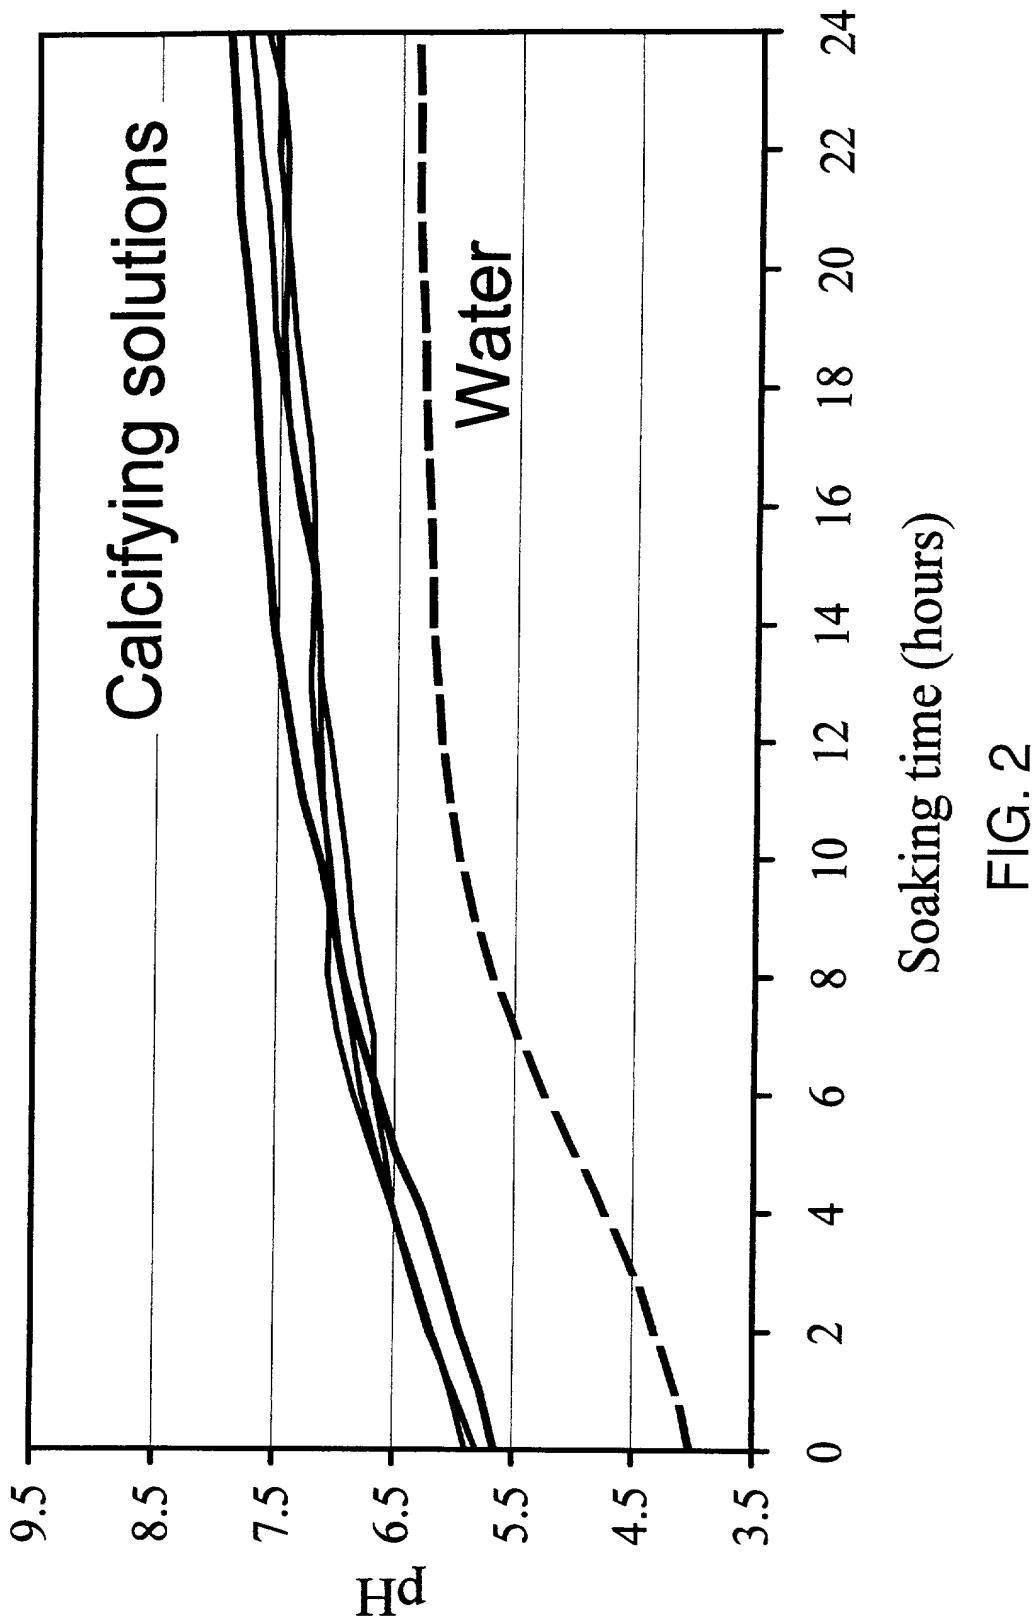


FIG. 2

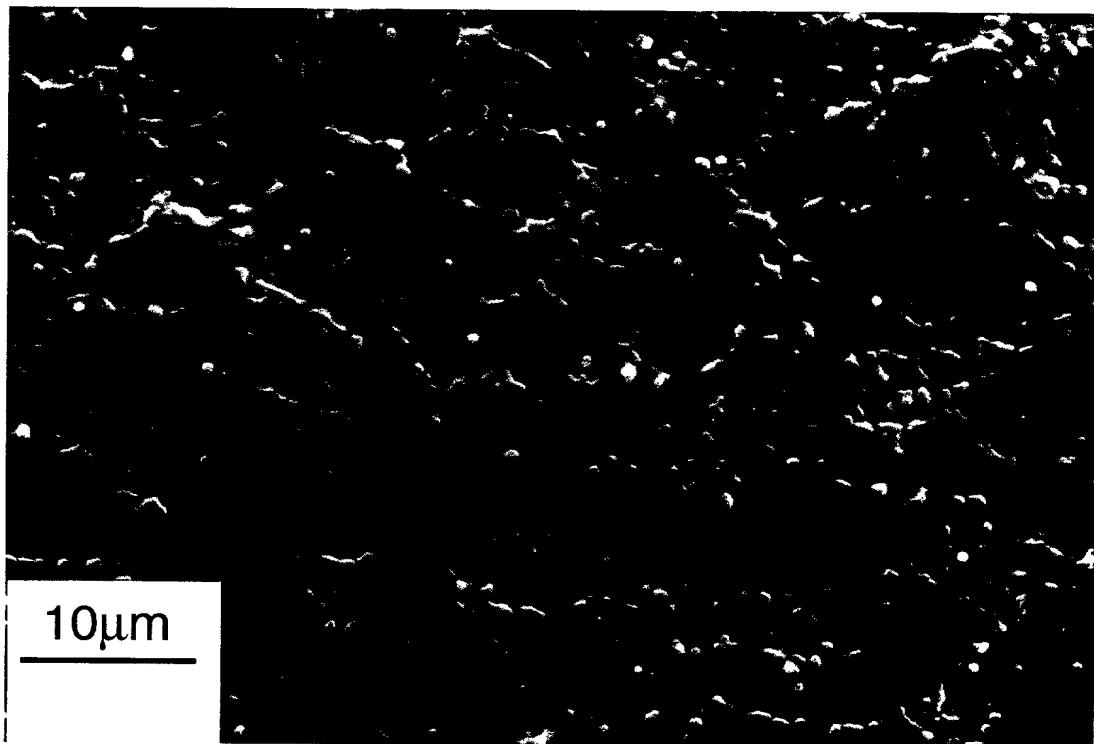


FIG. 3

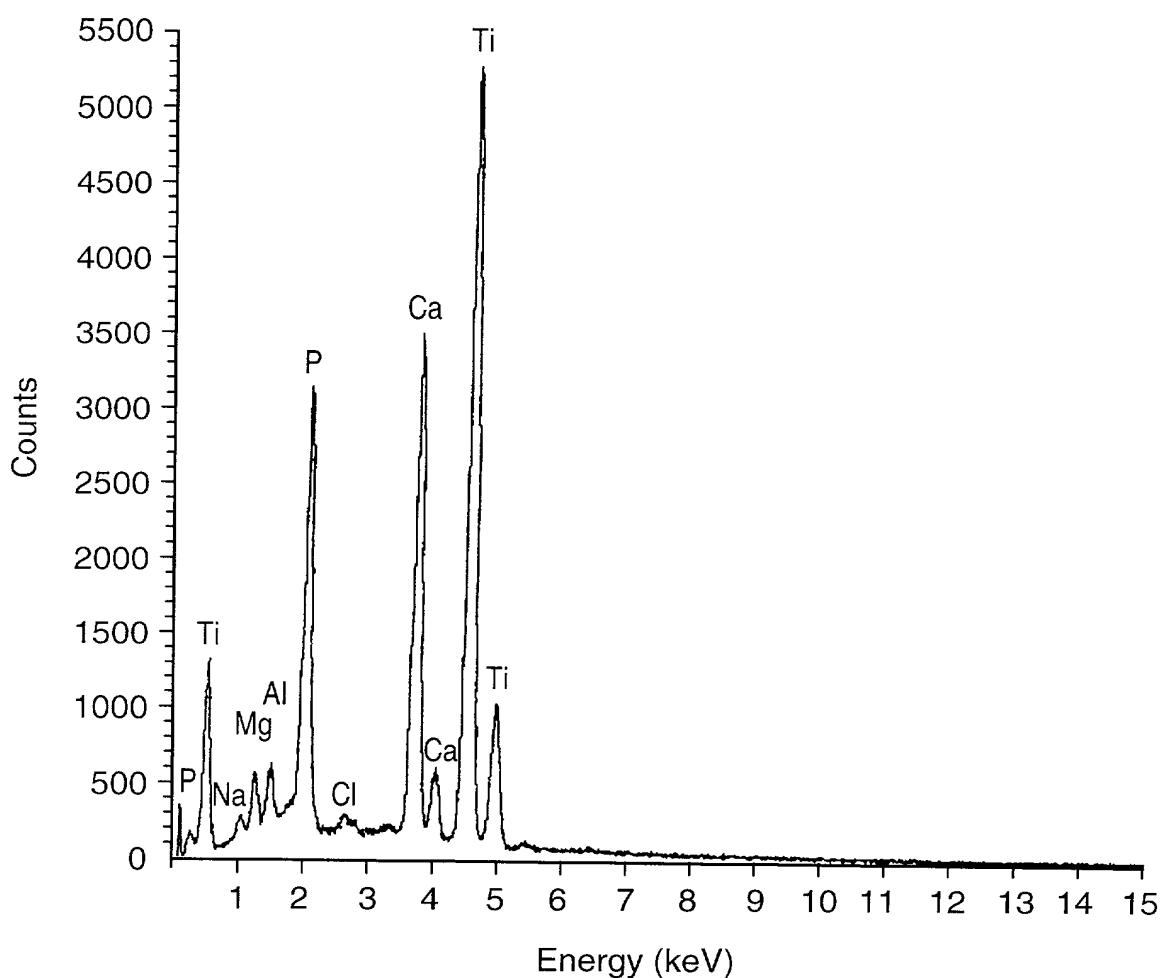


FIG. 4



FIG. 5

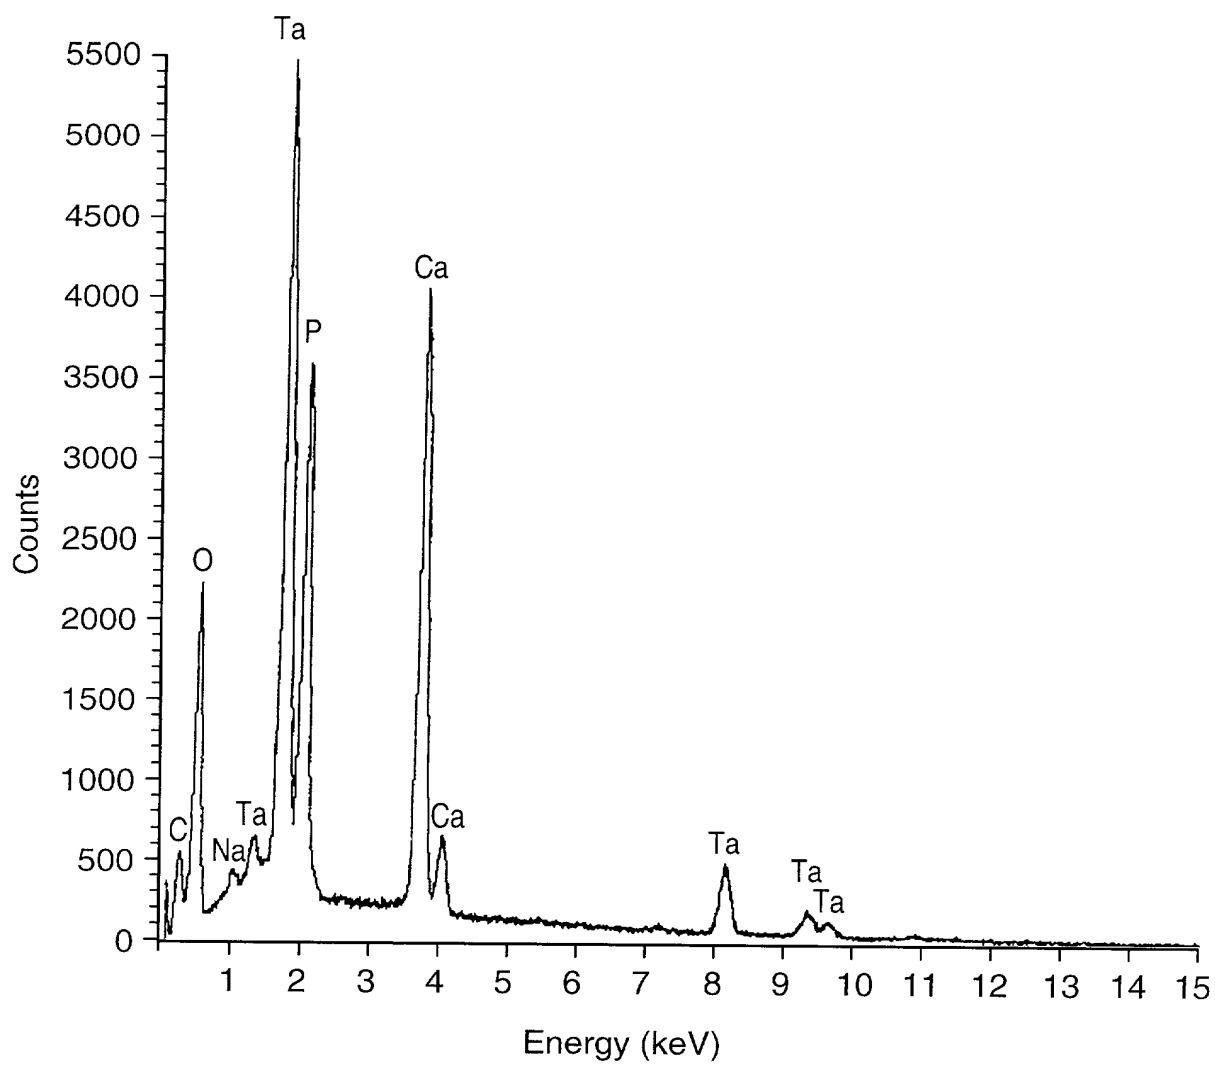


FIG. 6

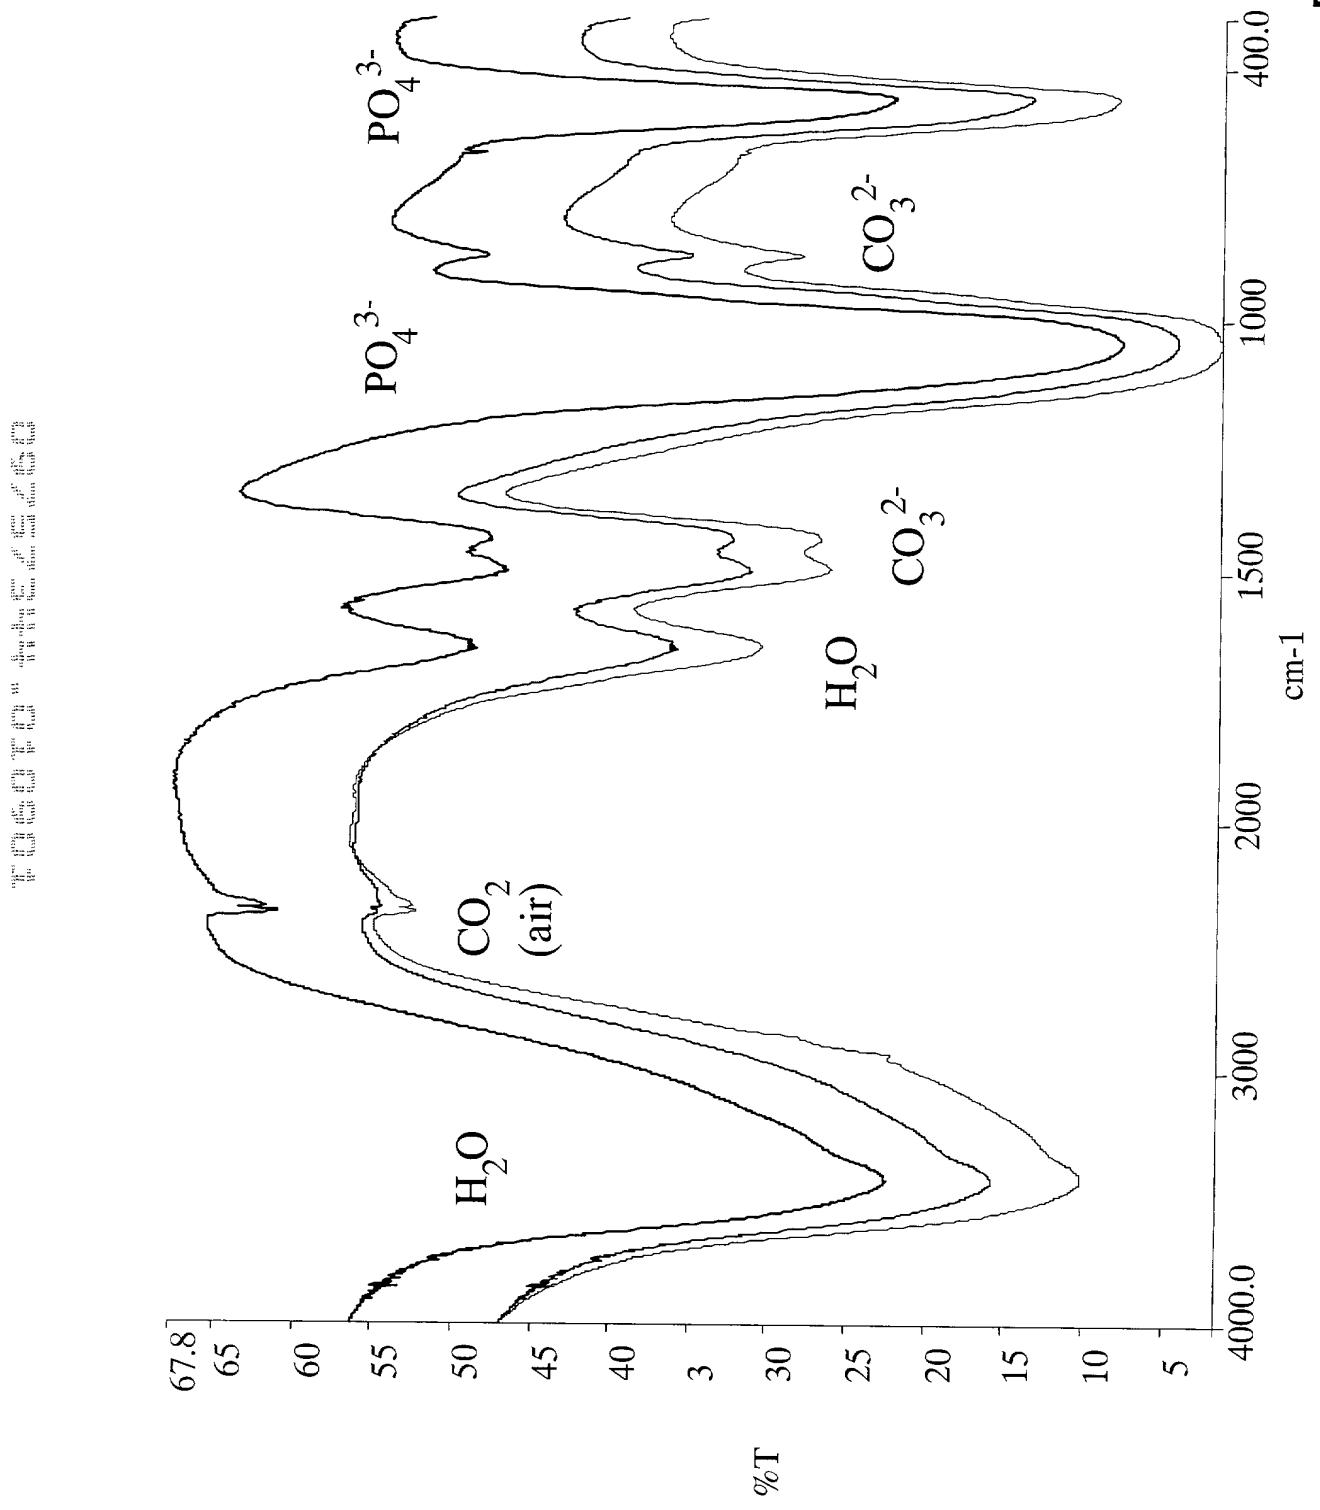


FIG. 7

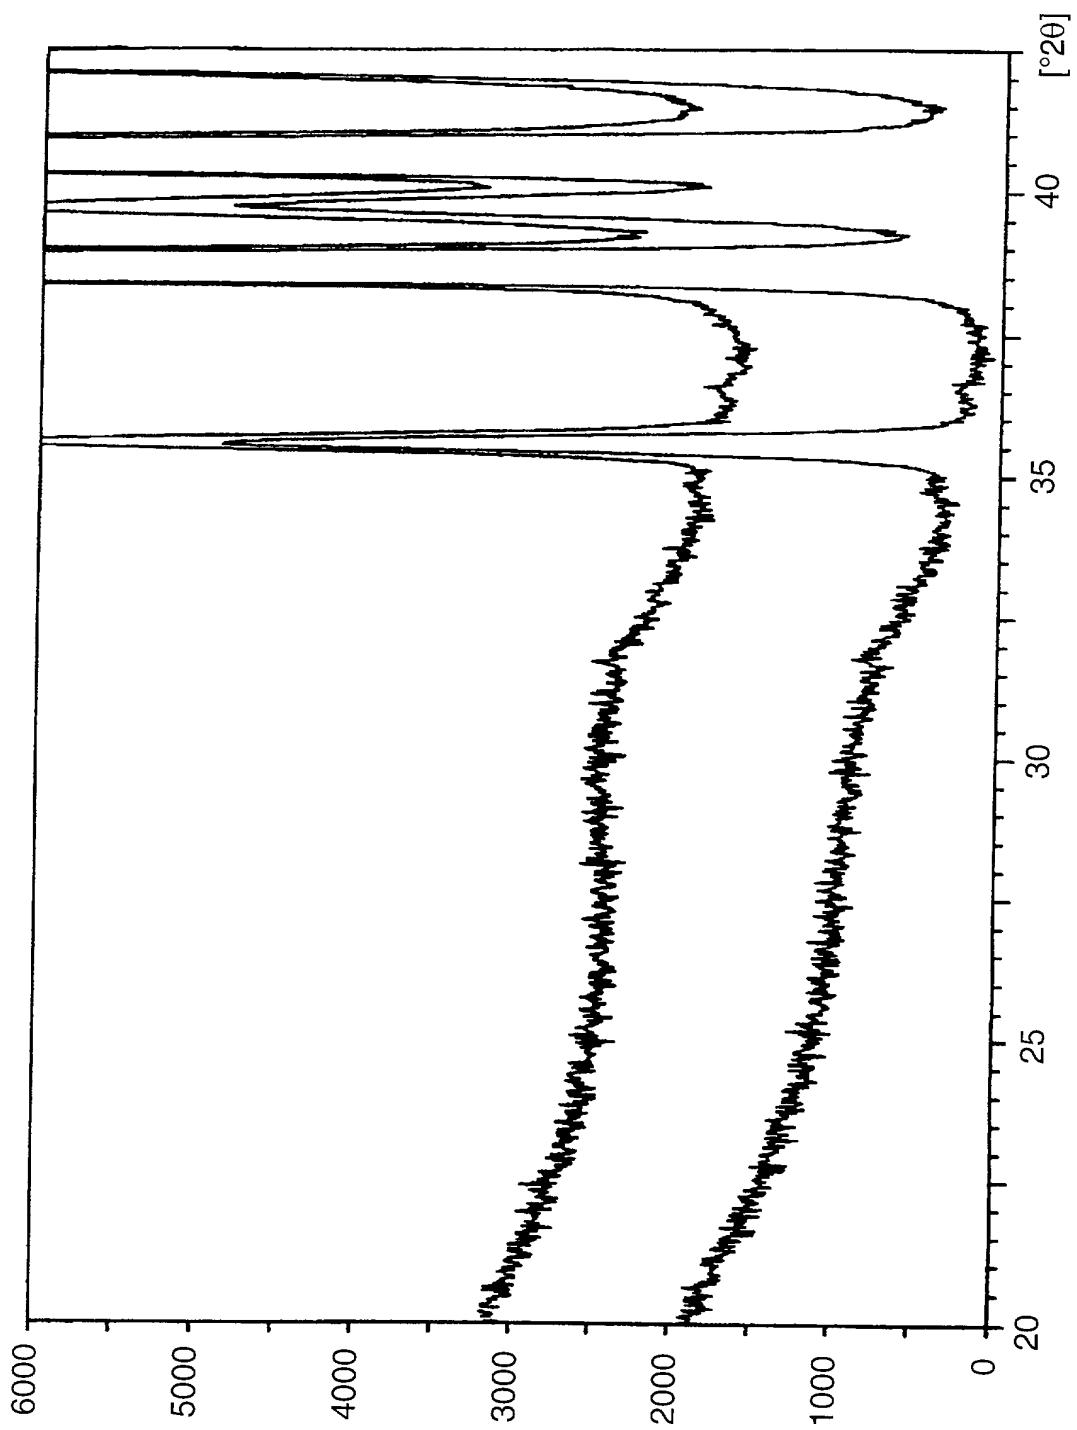


FIG. 8

9/9



1 mm 15.0 kV 5.05E1 0016/54 U9789A2

FIG. 9